


N

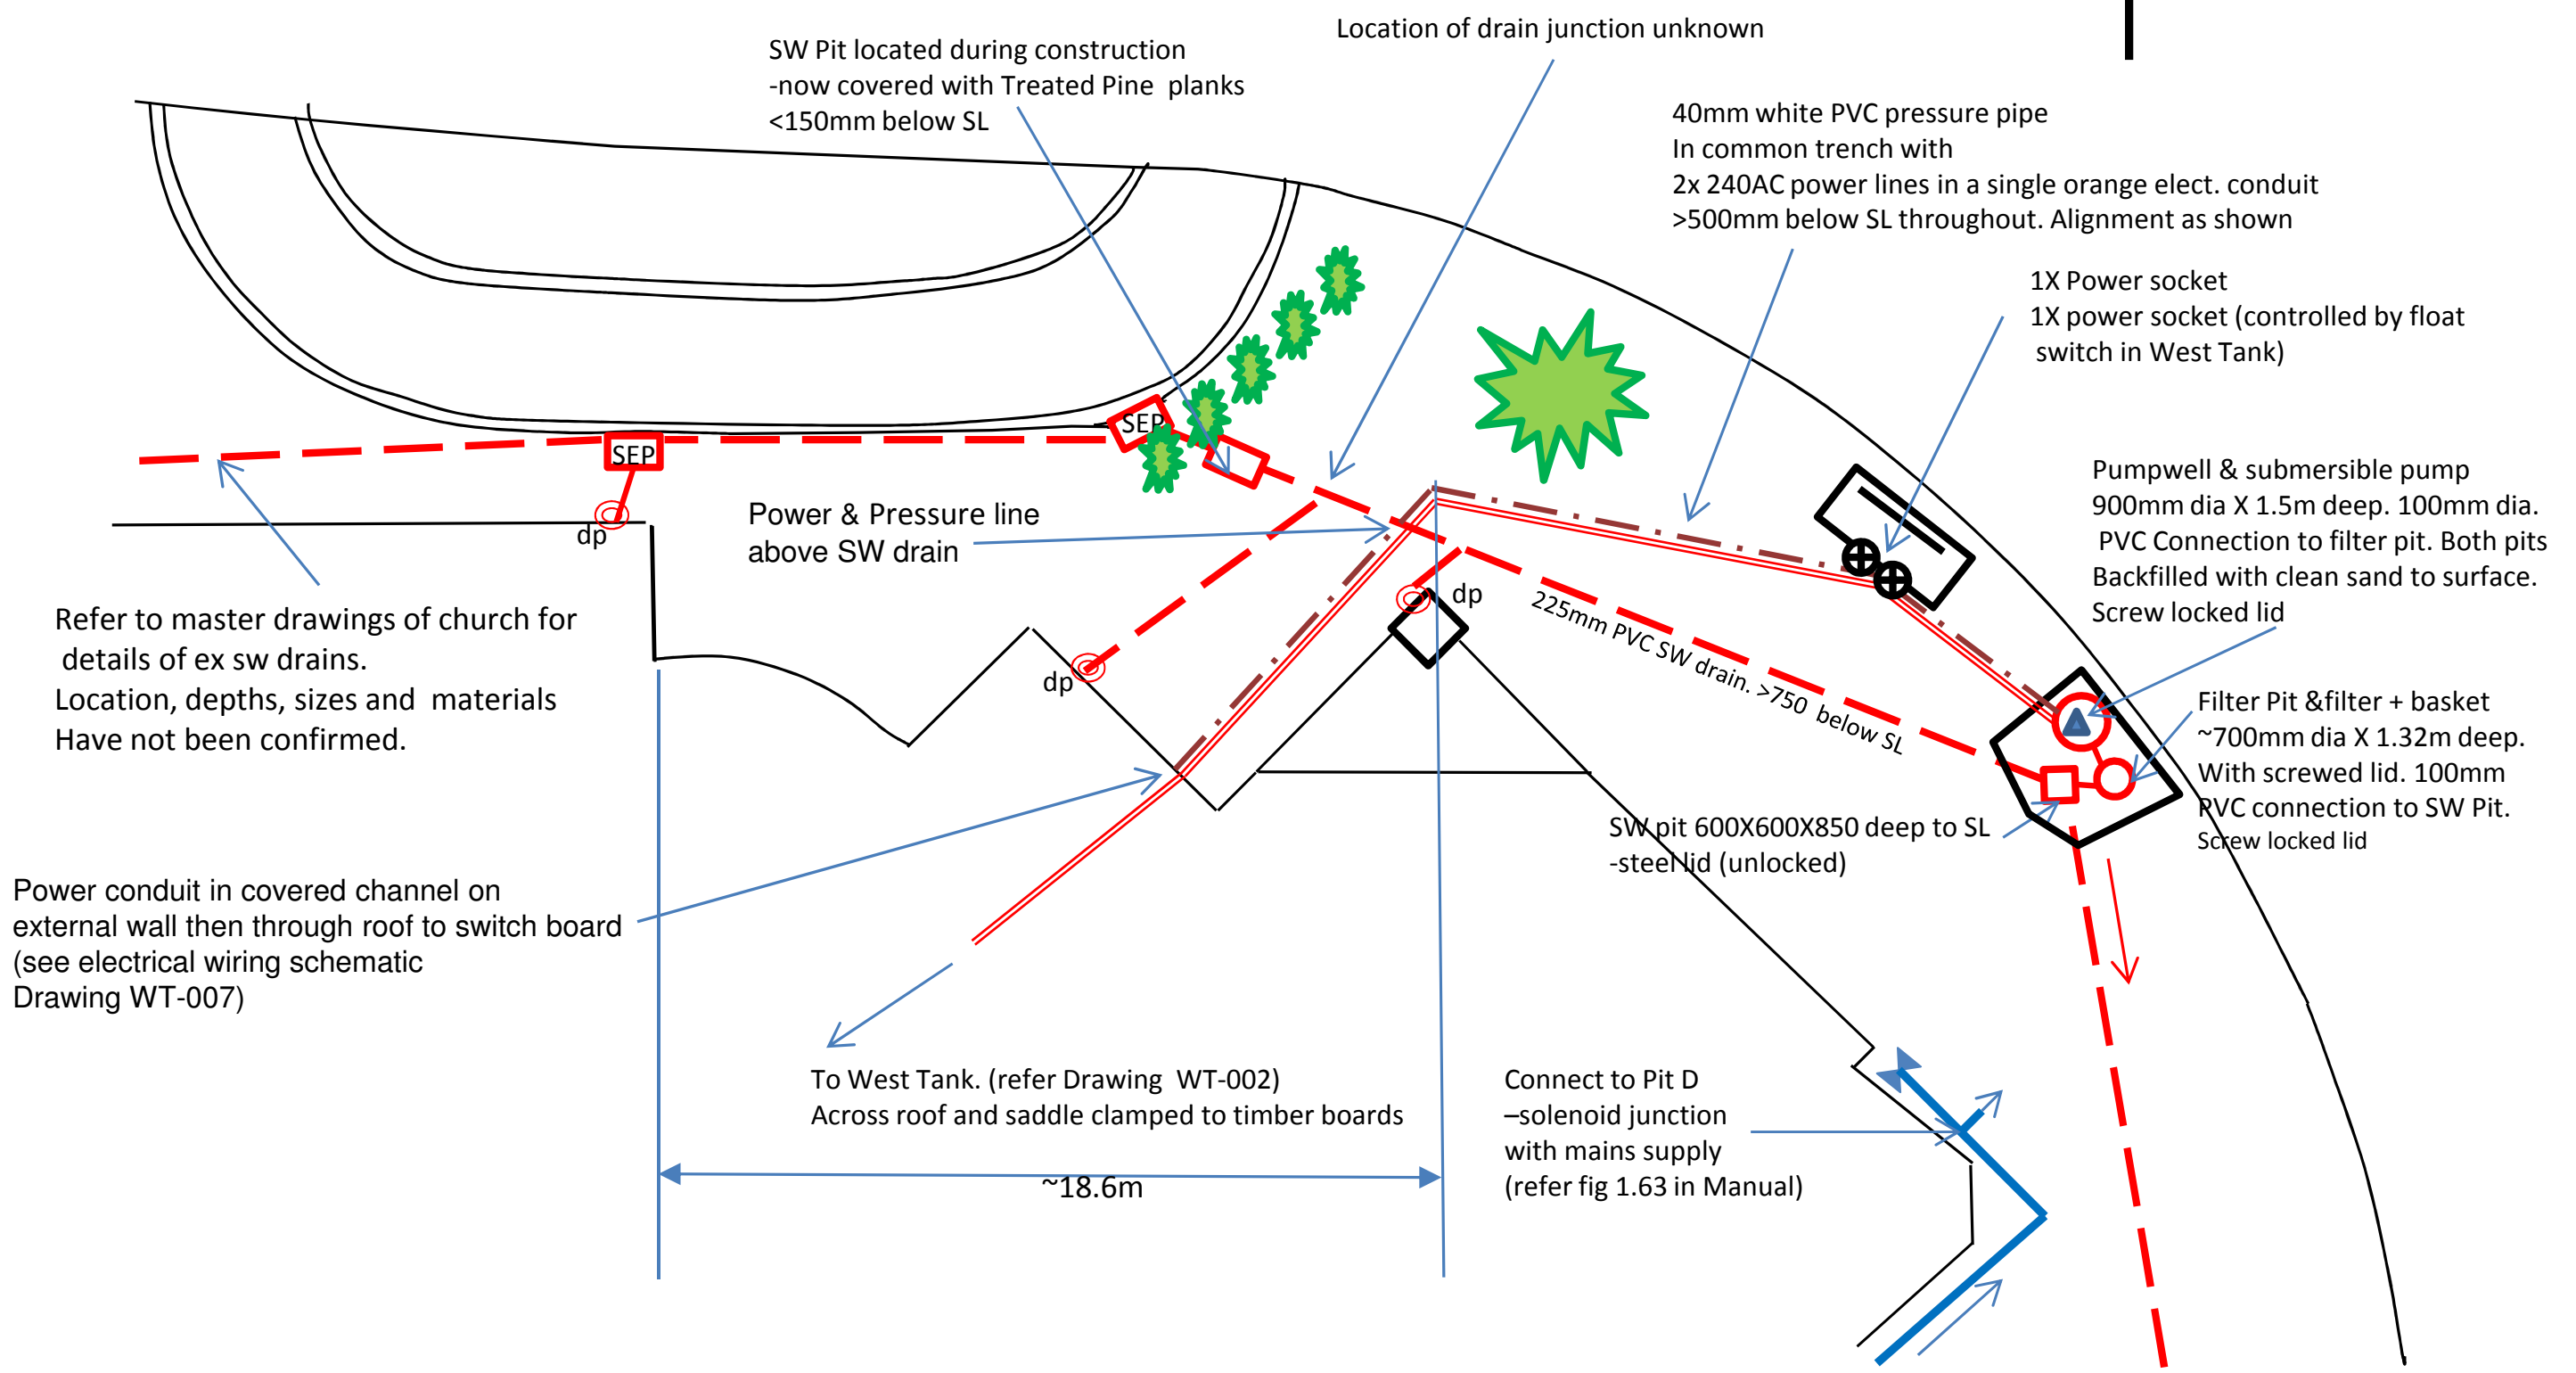

Refer to master drawings of church for details of ex sw drains. Location, depths, sizes and materials Have not been confirmed.


Power conduit in covered channel on external wall then through roof to switch board (see electrical wiring schematic Drawing WT-007)

To West Tank. (refer Drawing WT-002) Across roof and saddle clamped to timber boards

~18.6m

Connect to Pit D -solenoid junction with mains supply (refer fig 1.63 in Manual)

Figure : WT-005
 Scale (approx): as shown
 Drawn: RV
 Date : February 2011
 Revisions: Sept 2013, Feb.Mar 2015

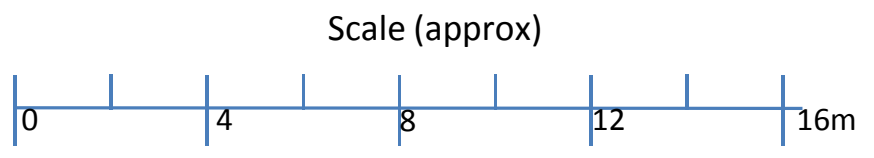

Glen Waverley Uniting Church
 Pumped system: Pipe locations
 Federal Community Water Grants Project 2007/8